


GRID CONNECTION

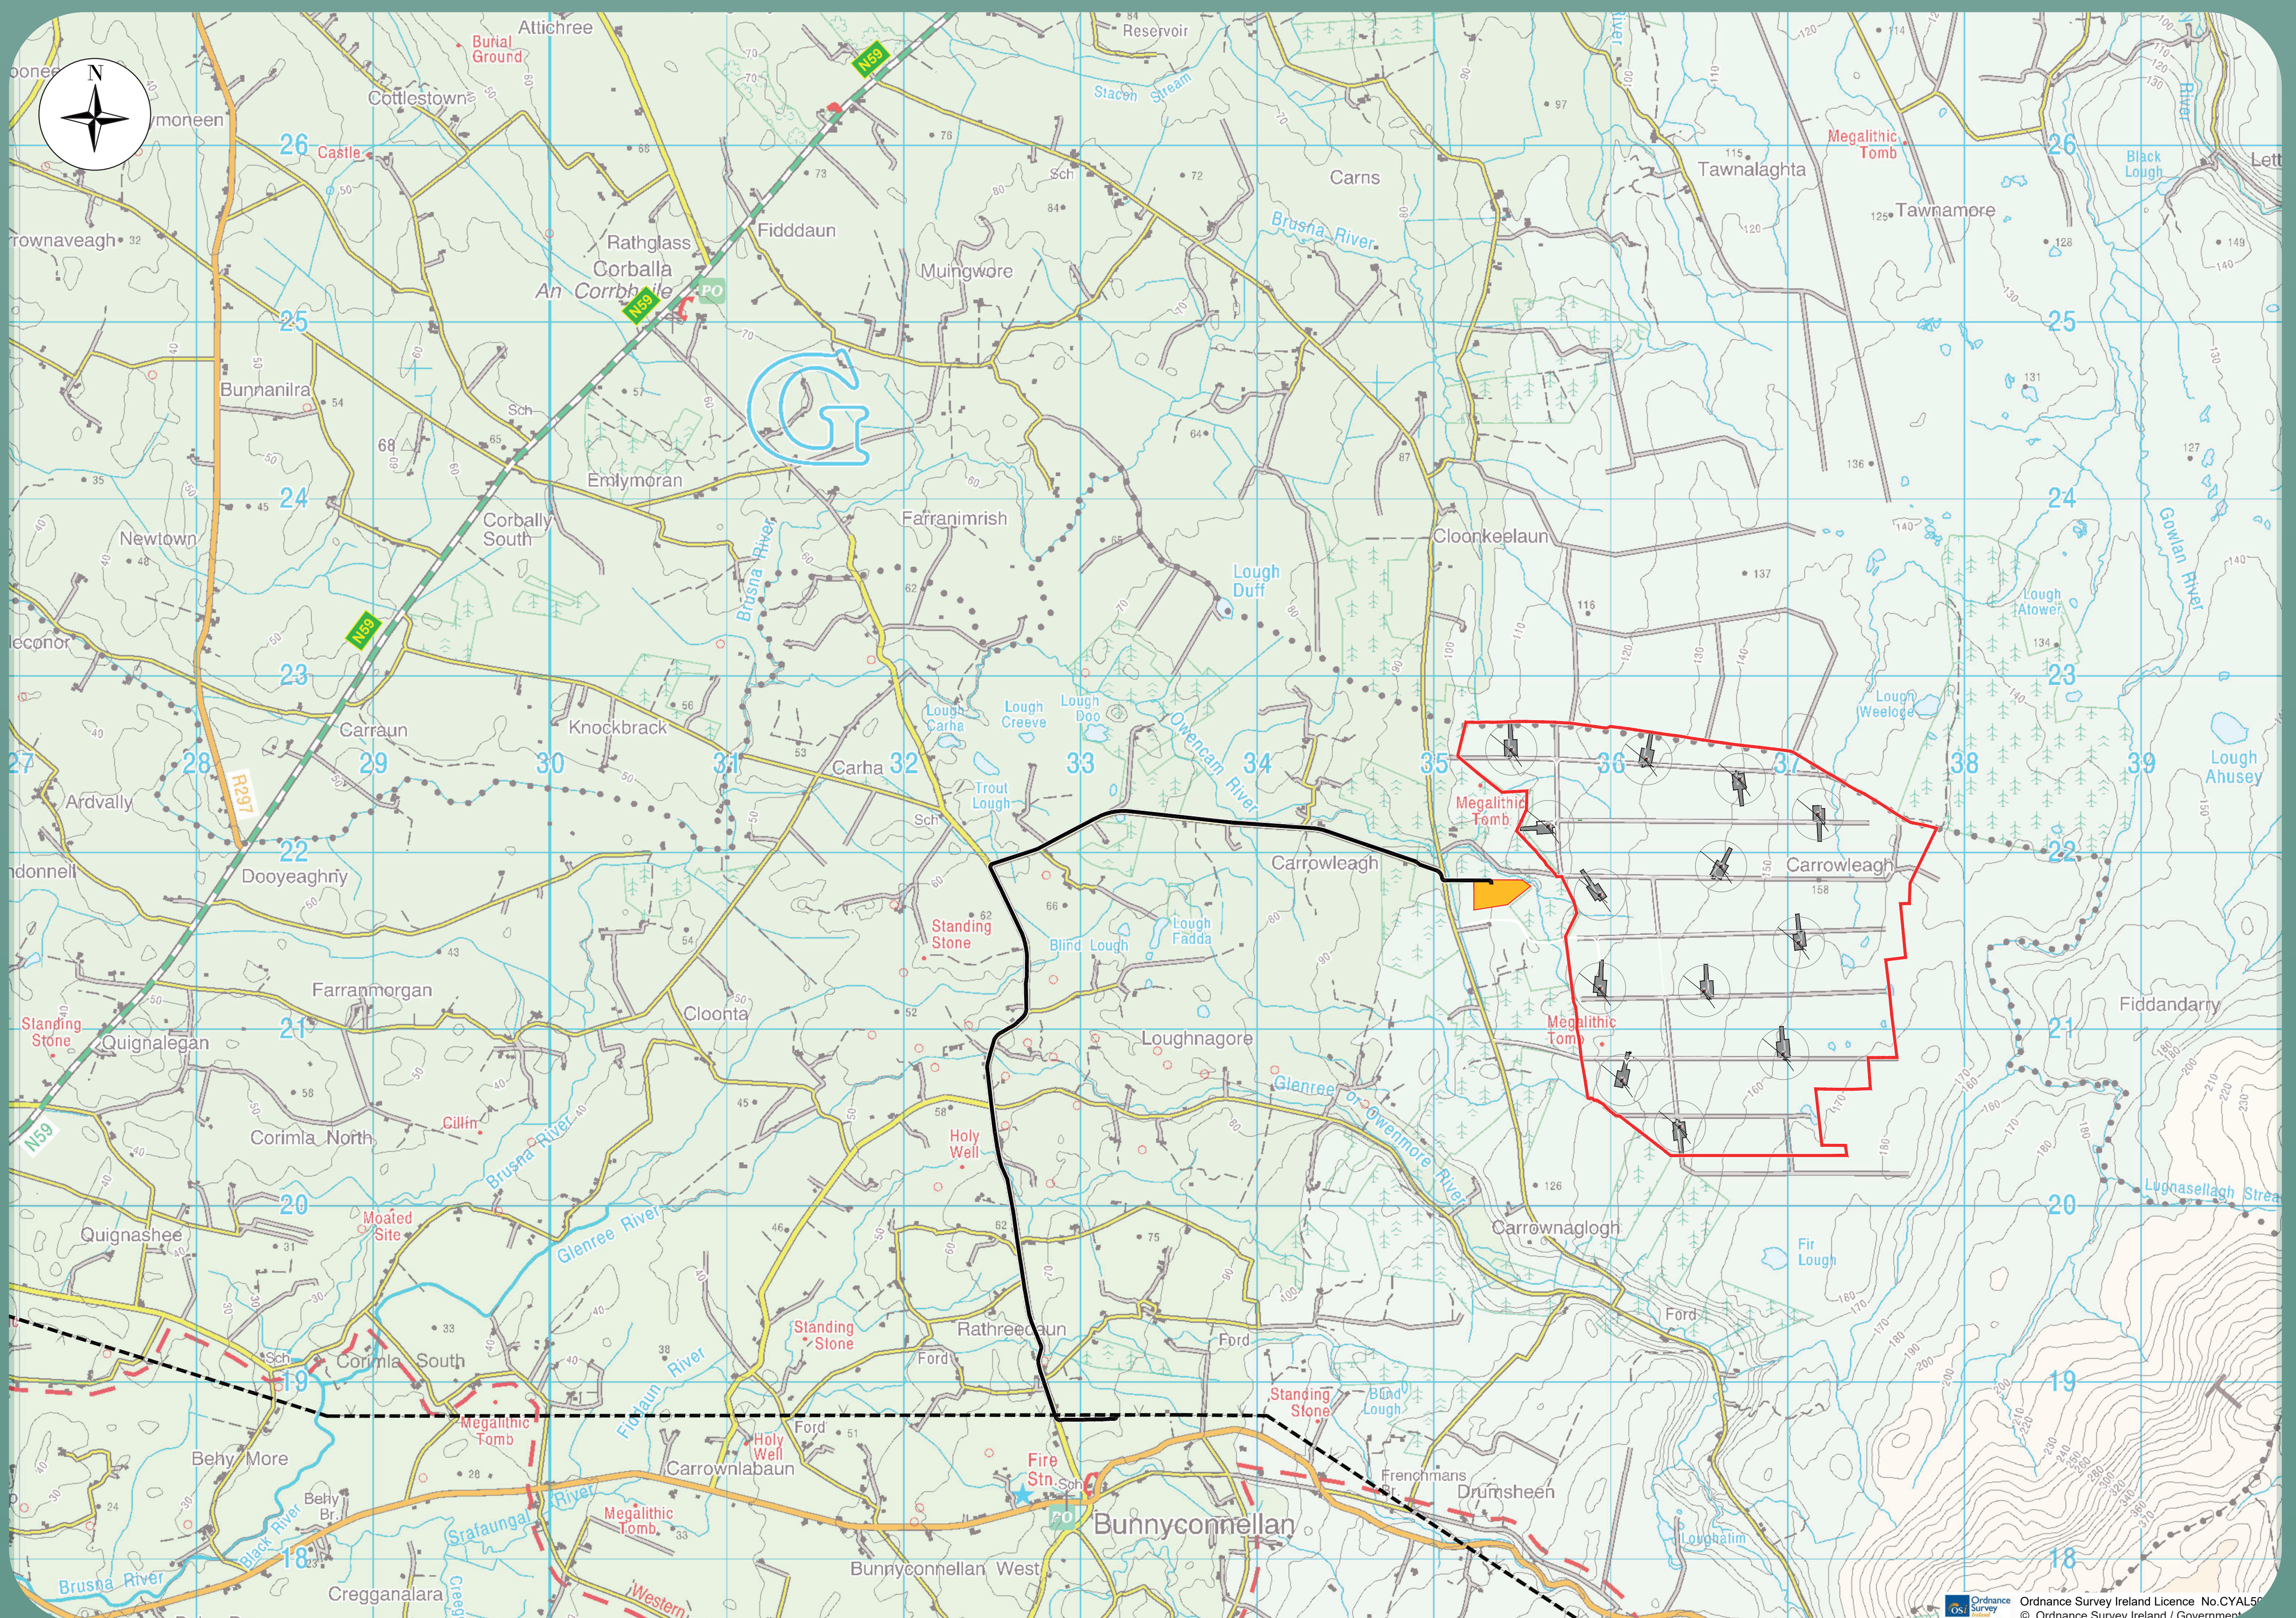

LEGEND

- Proposed Firlough Wind Farm Site
- Proposed Firlough Wind Turbine Locations
- Proposed Firlough Wind Farm Substation Site
- Proposed Grid Connection Route
- Existing Carrowleagh – Kilbride 110kV OHL

The proposed Grid Connection Route is approximately 6.7km in length and traverses in a westerly, then southerly direction from the Proposed Firlough Wind Farm Substation Site to the existing Carrowleagh – Kilbride 110kV Overhead Line (“OHL”).

It will consist of mainly underground cabling (“UGC”) with a small section of works in the vicinity of the tie in towers to connect to the existing Carrowleagh – Kilbride 110kV OHL.

The UGC works will consist of the installation of six ducts in an excavated trench to accommodate three power cables, two fibre communication cables and an earth continuity conductor.

The cable location will take into consideration Mayo County Council and other relevant stakeholders’ requirements. Installation of the cable will consider all environmental protection measures forming part of the planning application for the proposed development.